


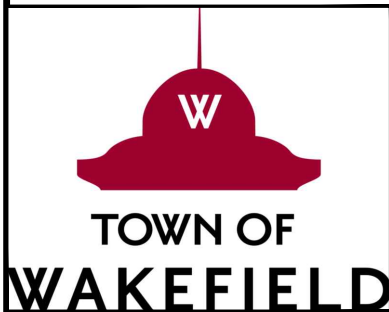


ENGINEERING DIVISION - WAKEFIELD PUBLIC WORKS

DESIGN AND CONSTRUCTION STANDARDS
DETENTION BASIN CROSS-SECTION

SCALE: NTS

DETAIL #: DR-12A

DATE: JUN 01 2021

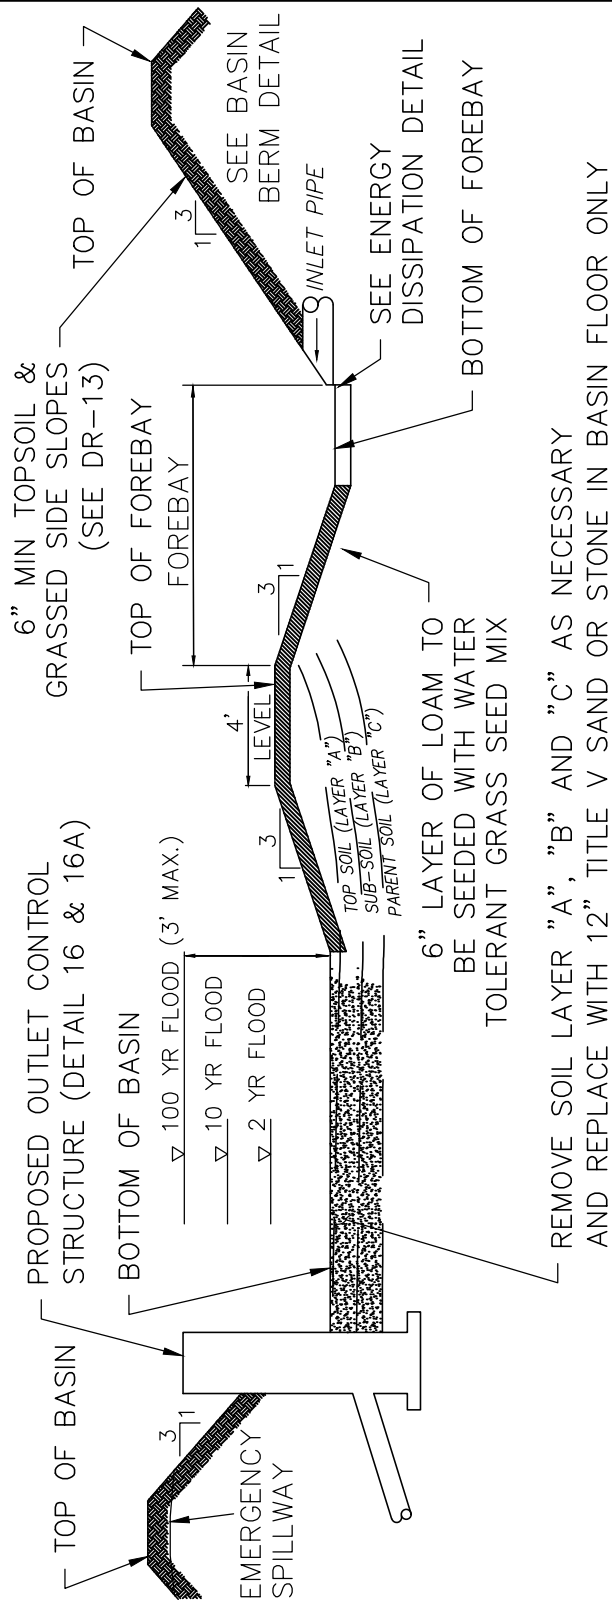

NOTES:

- 1.) THE BOTTOM OF THE BASIN SHALL BE SET A MINIMUM OF 2' ABOVE THE SEASONALLY HIGH GROUNDWATER TABLE.
- 2.) THE LOWEST PORTION OF THE BASIN FLOOR SHALL CONSIST OF A MINIMUM OF 12" OF TITLE V SAND OR STONE PLACED DIRECTLY OVER NATIVE "C" LAYER SOILS.

DRAFT