


PLAN VIEW

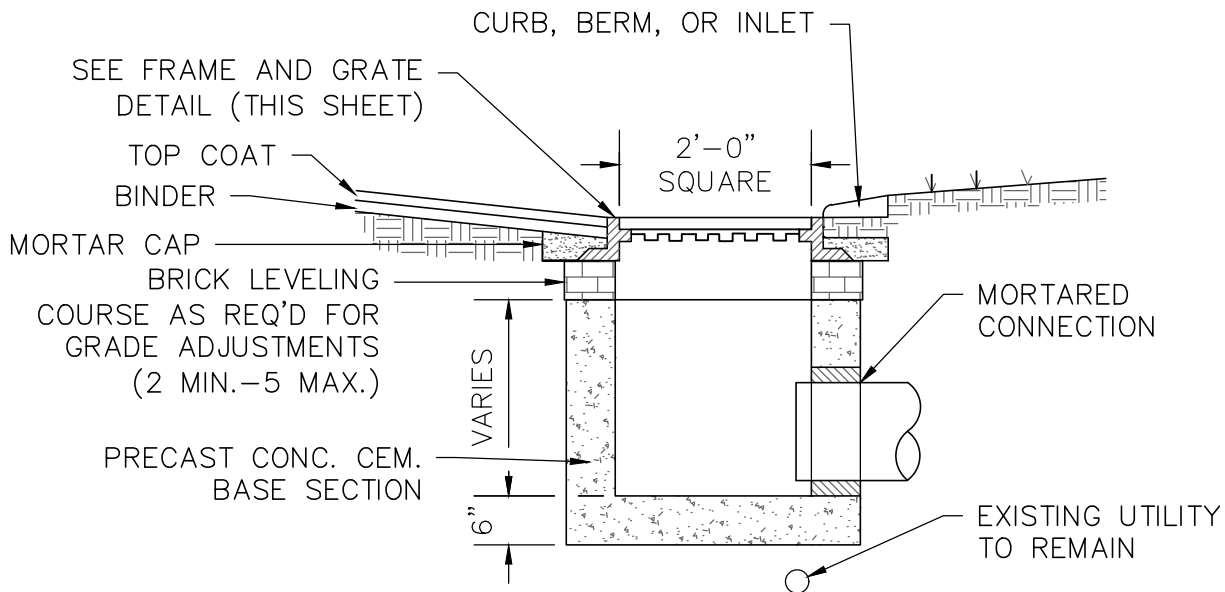


SECTION VIEW

NOTES:

1. PRECAST REINFORCED CONCRETE GUTTER INLET TO BE CAPABLE OF SUPPORTING H-20 LOADING.
2. GUTTER INLET MUST OUTLET TO STRUCTURE WITH MIN. 4' SUMP

DRAFT

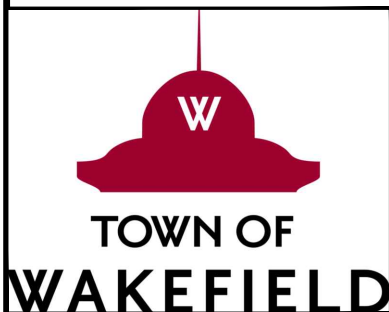

ENGINEERING DIVISION - WAKEFIELD PUBLIC WORKS

DESIGN AND CONSTRUCTION STANDARDS
GUTTER INLET DETAIL

SCALE: NTS

DETAIL #: DR-18

DATE: JUN 15 2022