



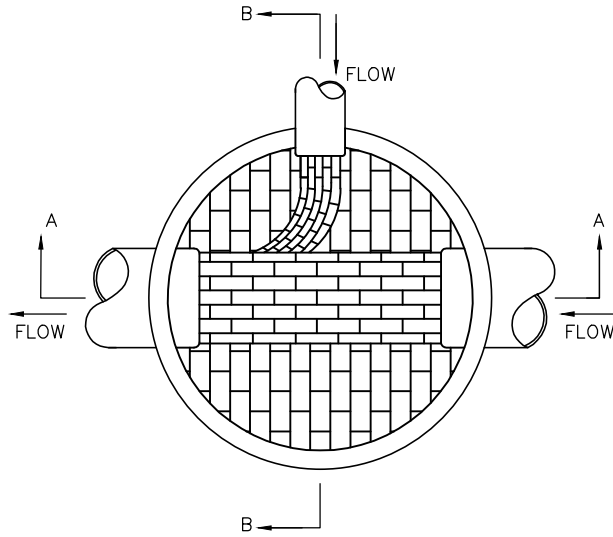


PLAN

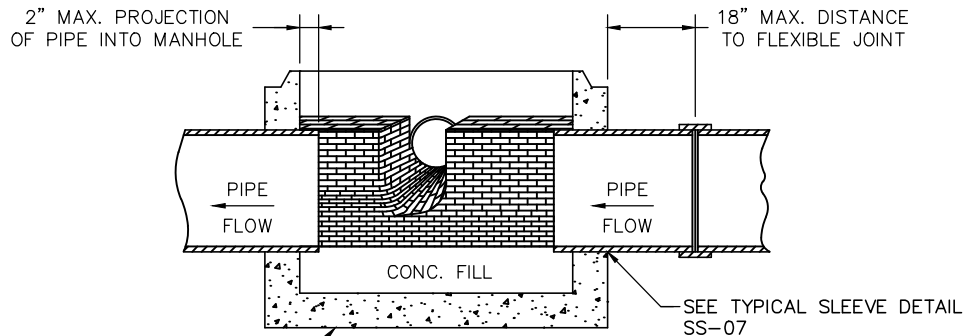

BASE SECTION TO BE FULL WALL THICKNESS AND MONOLITHIC TO A POINT 6" ABOVE THE PIPE CROWN


SECTION A-A

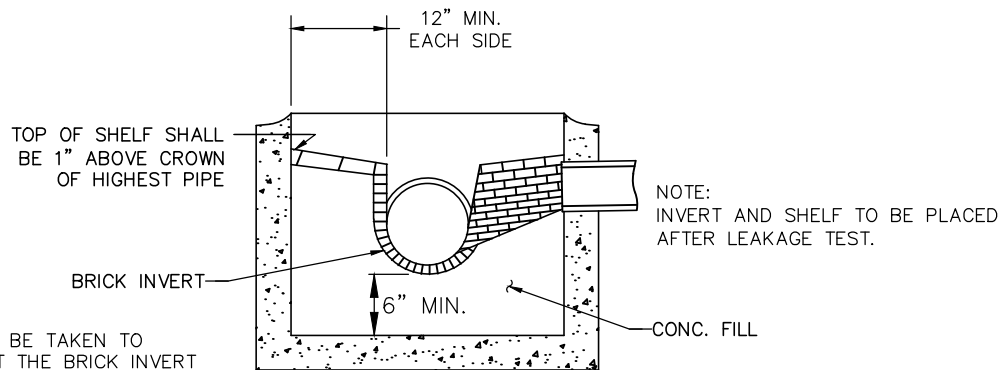

NOTE:
CARE SHALL BE TAKEN TO INSURE THAT THE BRICK INVERT IS A SMOOTH CONTINUATION OF THE SEWER INVERT. INVERT BRICKS SHALL BE LAID ON EDGE.

SECTION B-B

DRAFT

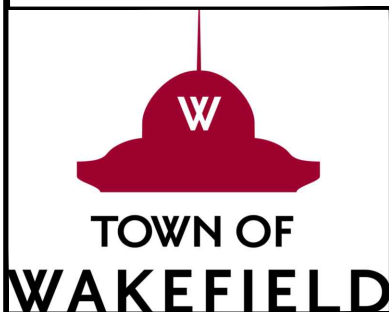

ENGINEERING DIVISION - WAKEFIELD PUBLIC WORKS

DESIGN AND CONSTRUCTION STANDARDS
SEWER MANHOLE INVERT DETAIL

SCALE: NTS

DETAIL #: SS-06

DATE: MAY 22 2023