


PLAN

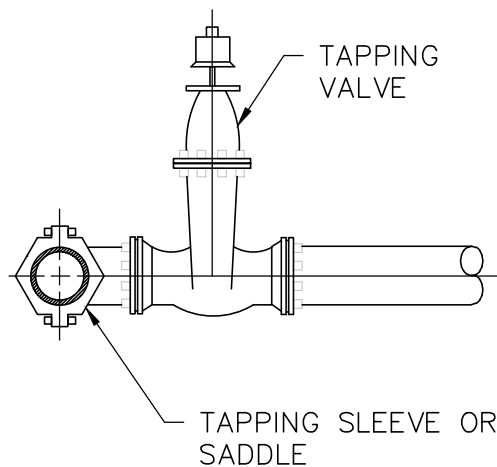


SIDE VIEW

NOTES:

1. TAPPING SLEEVE TO BE STAINLESS STEEL FOR 12" PIPE OR SMALLER.
2. TAPPING SLEEVE OR SADDLE IS TO BE COMPLETELY WRAPPED WITH 8 MIL POLYETHYLENE ENCASEMENT.
3. TAPPING SLEEVE AND SADDLE SHALL BE TESTED AT A MINIMUM OF 150 PSI FOR A MINIMUM OF 15 MINUTES WITH NO VISIBLE LEAKAGE.
4. SIZE ON SIZE TAPS SHALL REQUIRE FULLY ENCAPSULATED SPLIT TAPPING SLEEVES, WITH MECHANICAL JOINT FLANGED.

DRAFT

 <p>TOWN OF WAKEFIELD</p>	ENGINEERING DIVISION - WAKEFIELD PUBLIC WORKS		
	DESIGN AND CONSTRUCTION STANDARDS TAPPING SLEEVE AND SADDLE DETAIL		
	SCALE: NTS	DETAIL #: W-12	DATE: MAY 22 2023